
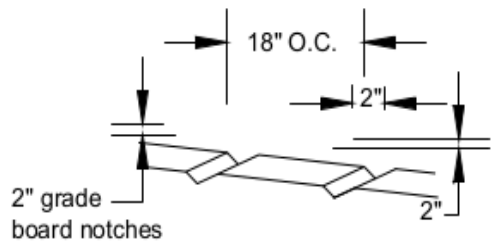


Plan

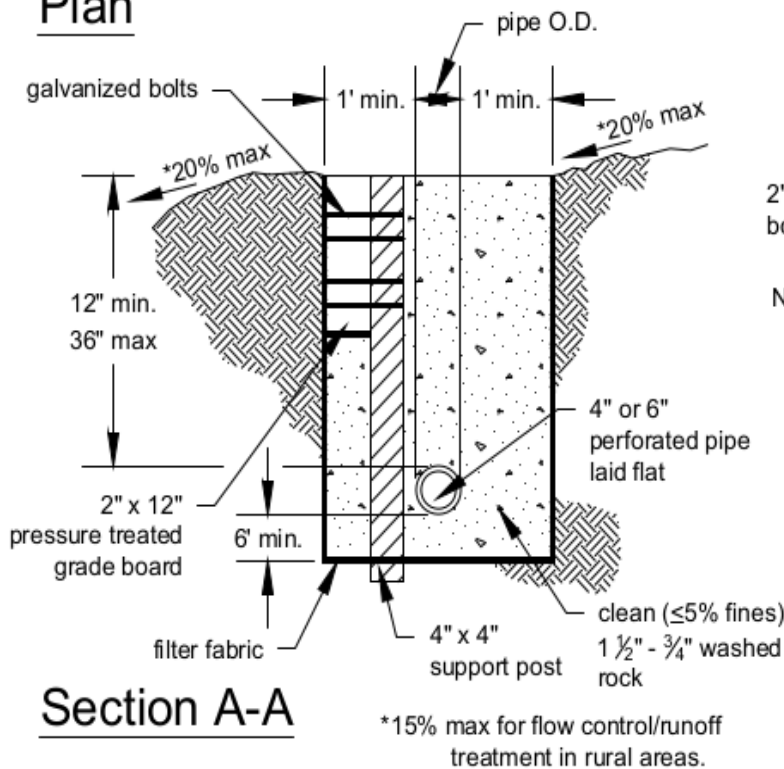

Notes:

1. This trench shall be constructed so as to prevent point discharge and/or erosion.
 2. Trenches may be placed no closer than 50 feet to one another. (100 feet along flowline)
 3. Trench and grade board must be level. Align to follow contours of site.
 4. Support post spacing as required by soil conditions to ensure grade board remains level.
 5. For roof area less than or equal to 700 square feet, structure shall be a small catch basin, yard drain, or Type 1 CB with with solid cover or equivalent as approved by the County.
 6. Structure shall be set back a minimum of 5 feet from building foundation.
- NOT TO SCALE



Figure II-4.1. Flow Dispersion Trench